


EM=666

LCMS Scan ESI+

Ret. Time: 2.70 <<<< POSITIVE SPECTRA >>>>

1

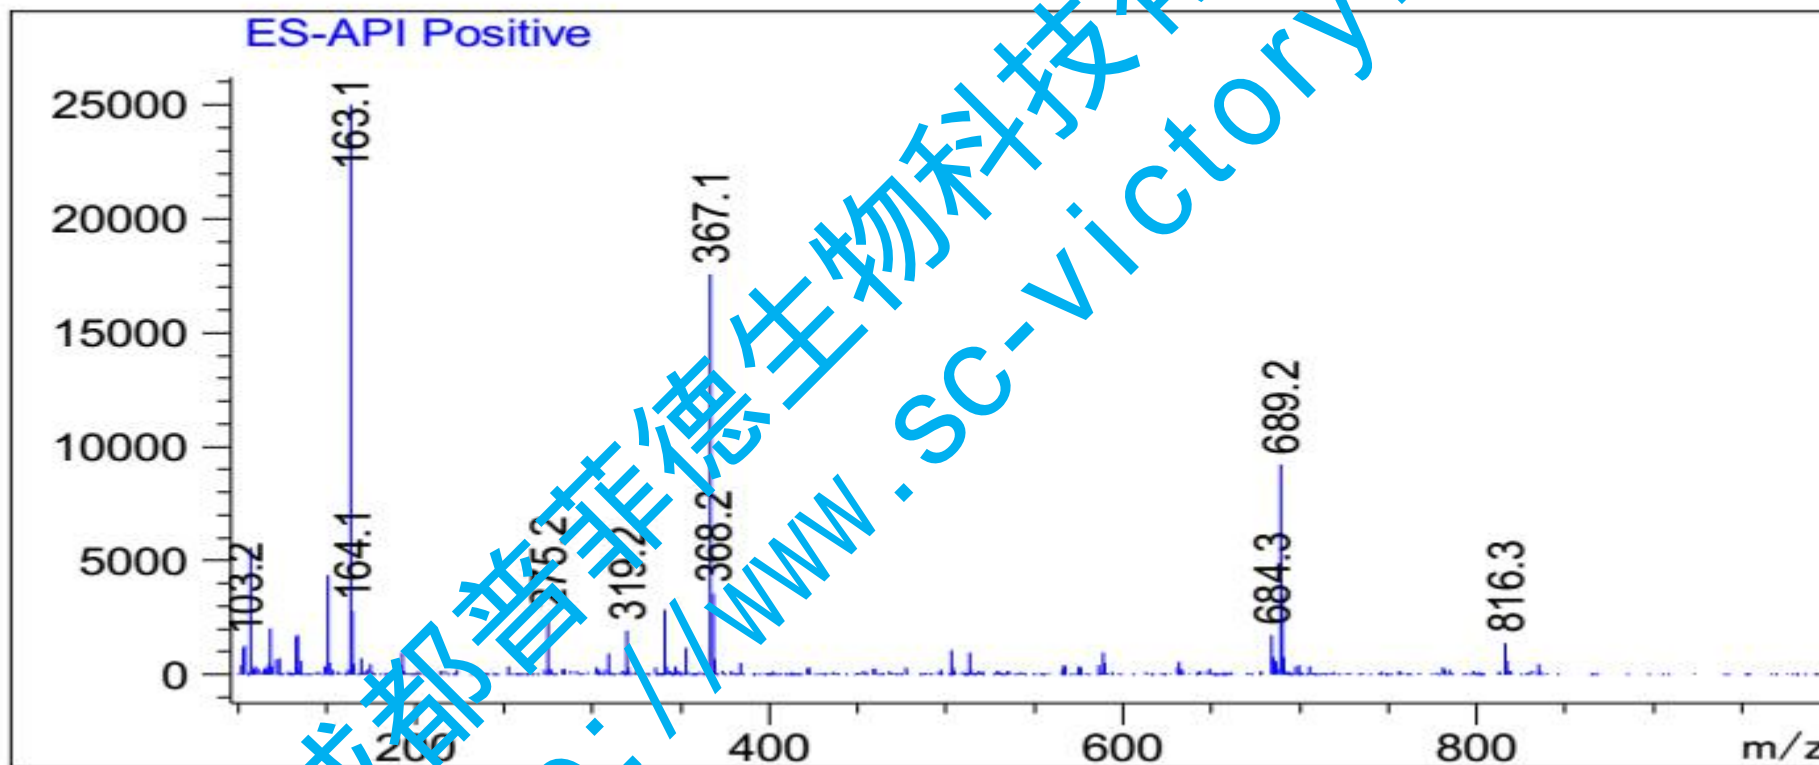


成都普菲德生物科技有限公司
http://www.sc-victory.com

EM=666

LCMS Scan ESI-

Ret. Time: 2.71 <<<< NEGATIVE SPECTRA >>>>

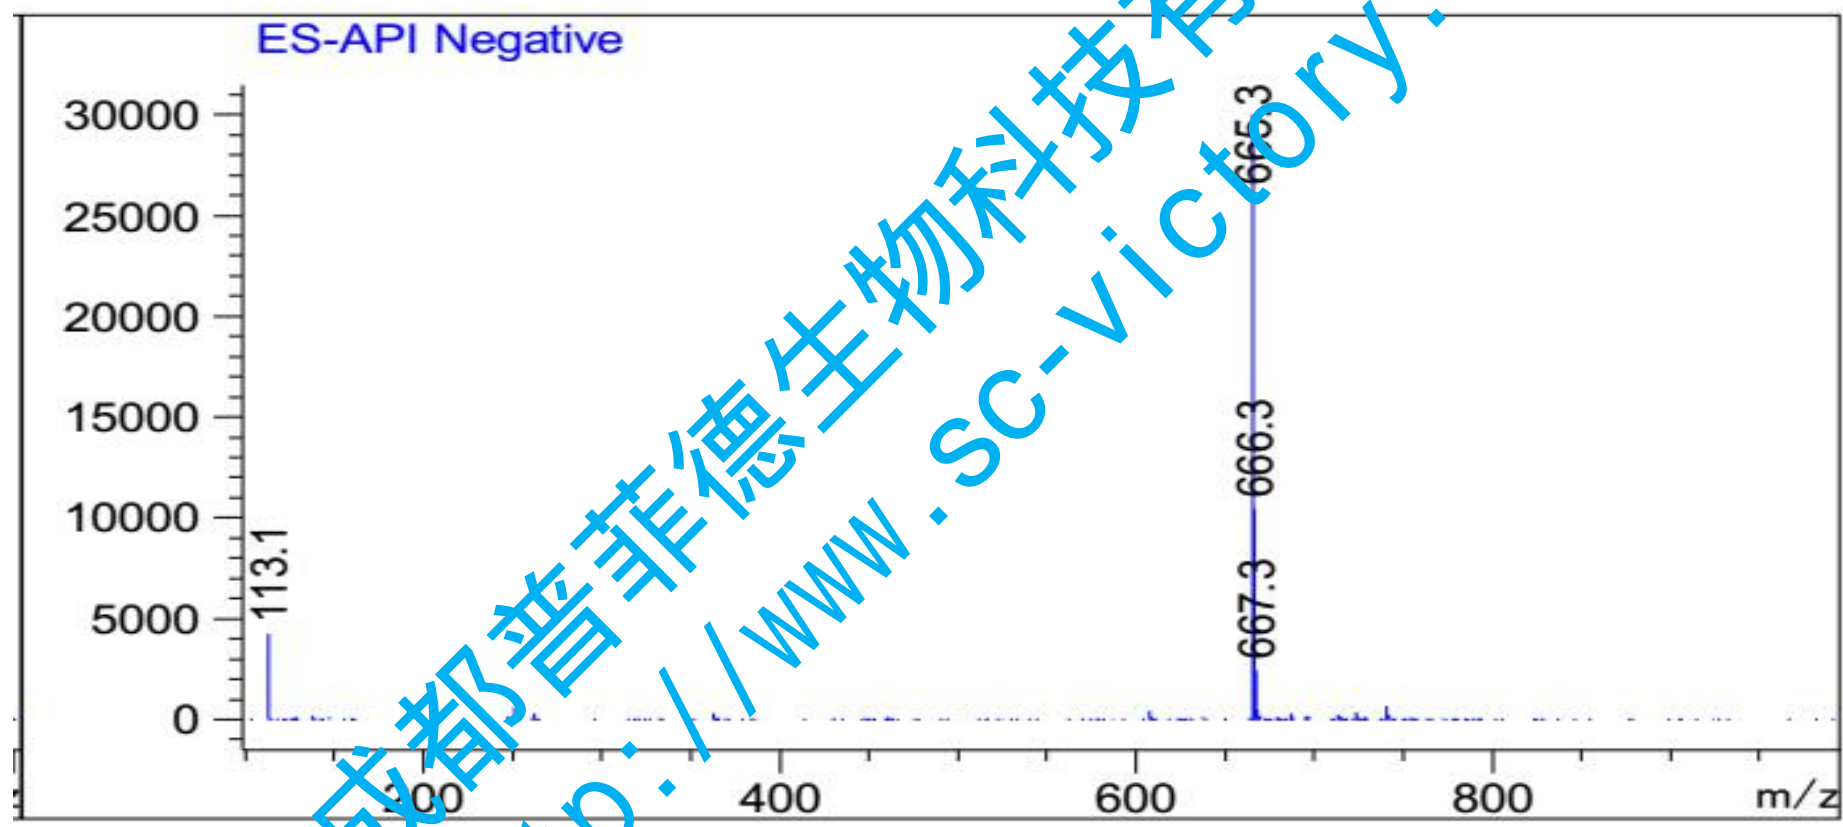

成都普菲德生物科技有限公司
http://www.sc-victory.com