


EM=430

LCMS Scan ESI+

Ret. Time: 1.88 <<<< POSITIVE SPECTRA >>>>

I

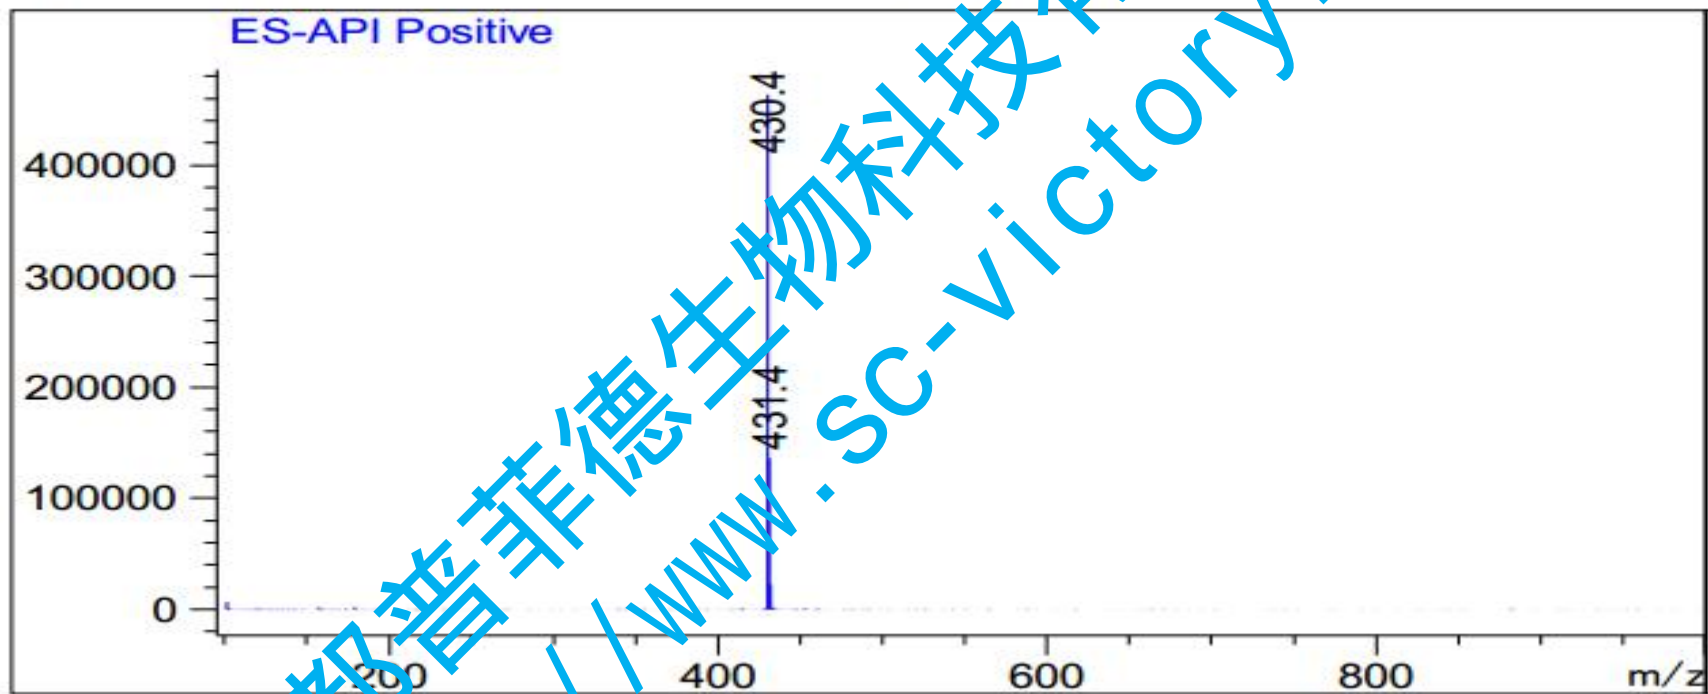

成都普菲德生物科技有限公司
<http://www.sc-victory.com>